



ALL WORK SHALL BE ACCOMPLISHED IN ACCORDANCE WITH THE LATEST EDITION OF THE WSDOT STANDARD SPECIFICATIONS FOR ROAD, BRIDGE, AND MUNICIPAL CONSTRUCTION

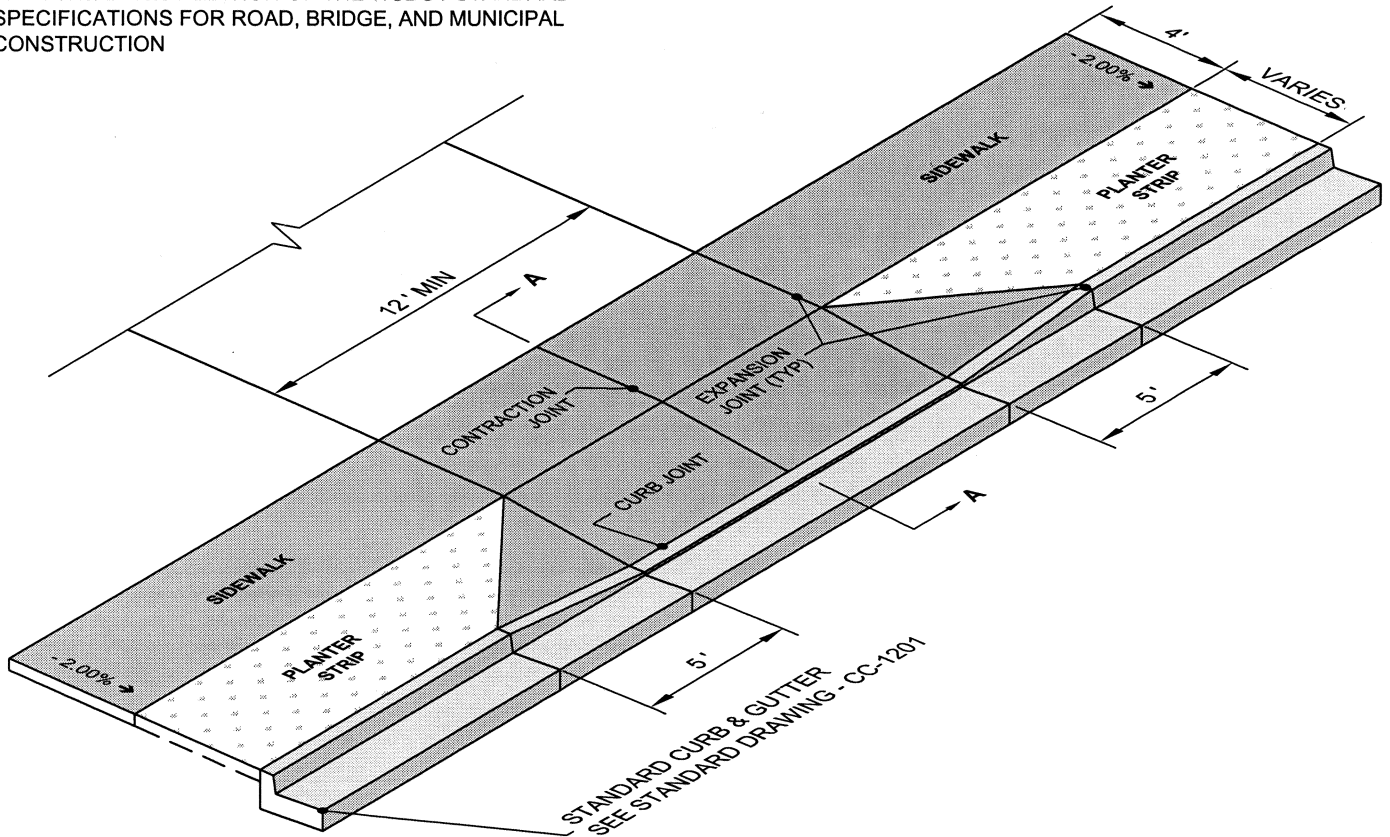

**ISOMETRIC VIEW**

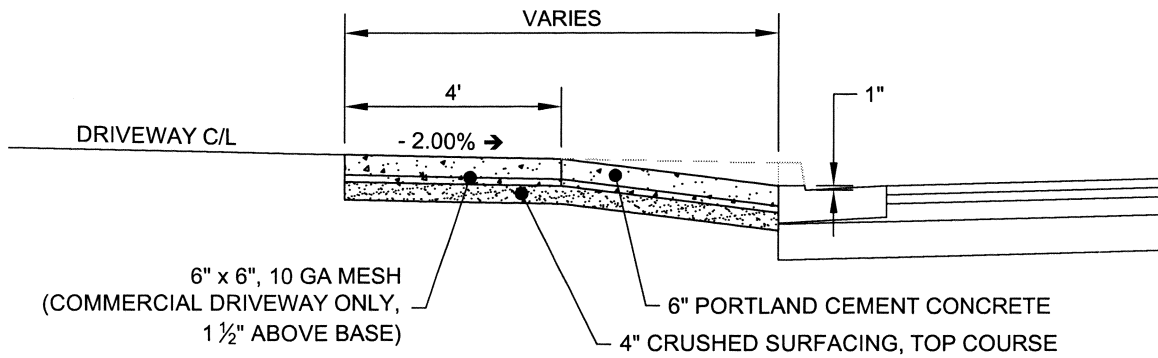

**SECTION "A-A"**


**NOTES:**

1. Concrete shall have a minimum breaking strength of 3000 p.s.i. after 28 days - 6 sack mix.
2. Curb joint shall be a troweled joint with a minimum  $\frac{1}{2}$ " radius adjacent to the back of curb.
3. Expansion joints shall be  $\frac{3}{8}$ " premolded, and conform to WSDOT Spec. 9-04.1.
4. Finish to be broomed perpendicular to the curb/gutter line.

RGL  
 DESIGNED BY  
 SA 6/7/07  
 DRAWN BY  
 RAC  
 APPROVED BY  
 6-7-07  
 DATE

**STANDARD APPROACH  
 FOR CURB AND GUTTER**

**DETACHED SIDEWALK  
 N T S**



DEPARTMENT  
 OF PUBLIC  
 WORKS  
 207 4th AV. NORTH  
 KELSO, WASHINGTON  
 98626  
**DRAWING:CC-1315**

SHEET  
**1**  
 OF  
**1**