



ALL WORK SHALL BE ACCOMPLISHED IN ACCORDANCE WITH THE LATEST EDITION OF THE WSDOT STANDARD SPECIFICATIONS FOR ROAD, BRIDGE, AND MUNICIPAL CONSTRUCTION

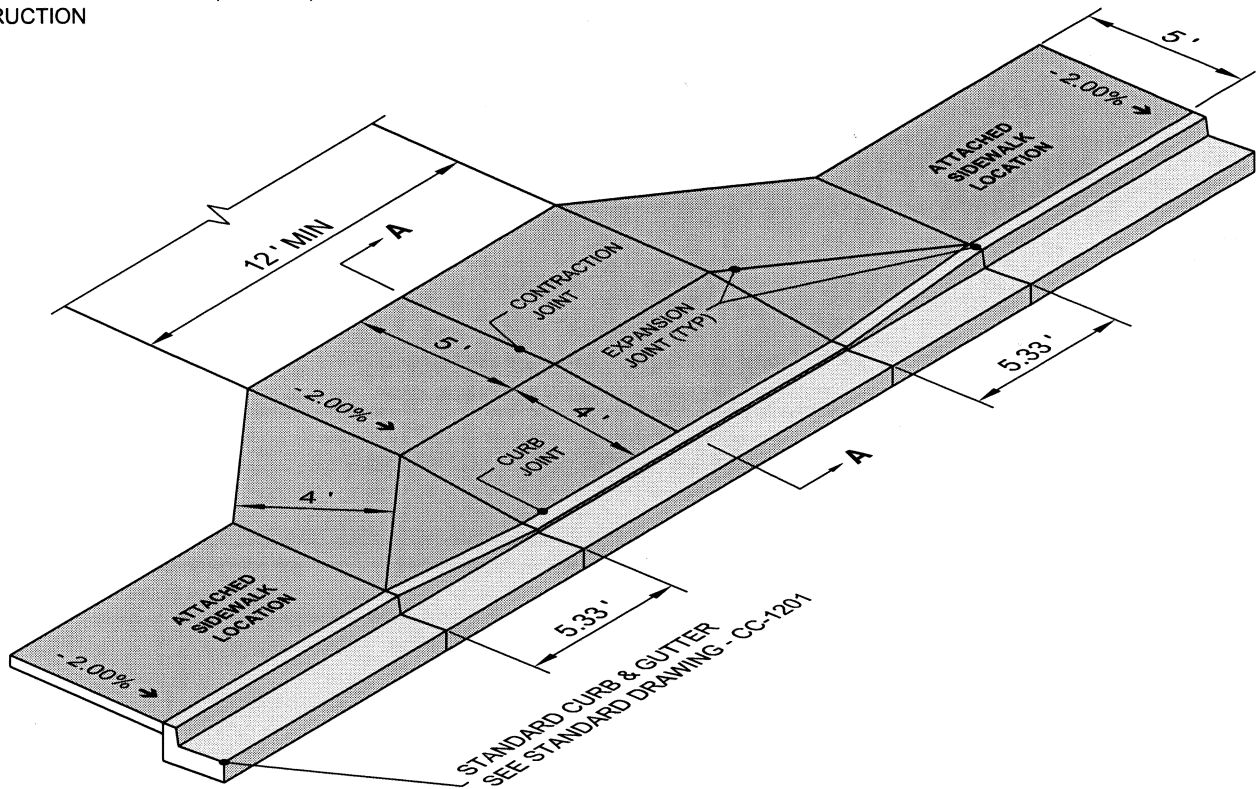


ISOMETRIC VIEW

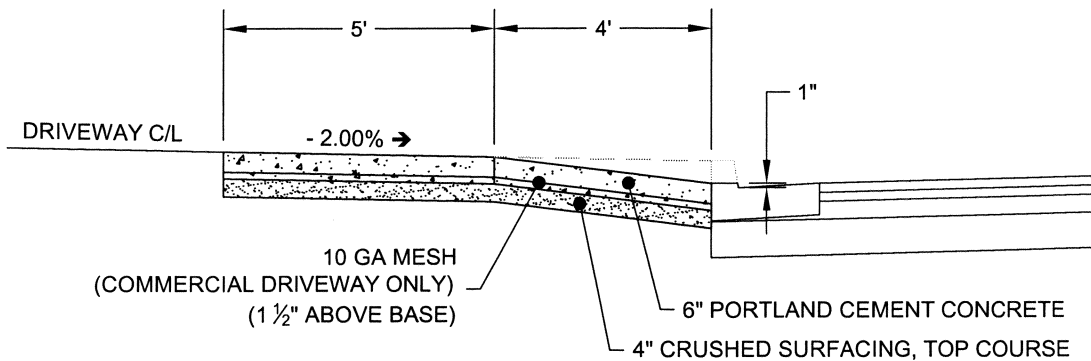

SECTION "A-A"

NOTES:

1. Concrete shall have a minimum breaking strength of 3000 p.s.i. after 28 days - 6 sack mix.
2. Curb joint shall be a troweled joint with a minimum $\frac{1}{2}$ " radius adjacent to the back of curb.
3. Expansion joints shall be $\frac{3}{8}$ " premolded, and conform to WSDOT Spec. 9-04.1.
4. Finish to be broomed perpendicular to the curb/gutter line.

<p>RGL DESIGNED BY SA 6/7/07 DRAWN BY <i>KAC</i> APPROVED BY 6-7-07 DATE</p>	<p>STANDARD APPROACH FOR CURB AND GUTTER</p> <p>ATTACHED SIDEWALK</p> <p>N T S</p>		<p>DEPARTMENT OF PUBLIC WORKS</p> <p>207 4th AV. NORTH KELSO, WASHINGTON 98626</p> <p>DRAWING:CC-1316</p>	<p>SHEET 1 OF 1</p>
---	---	--	--	---