



ALL WORK SHALL BE ACCOMPLISHED IN ACCORDANCE WITH THE LATEST EDITION OF THE WSDOT STANDARD SPECIFICATIONS FOR ROAD, BRIDGE, AND MUNICIPAL CONSTRUCTION

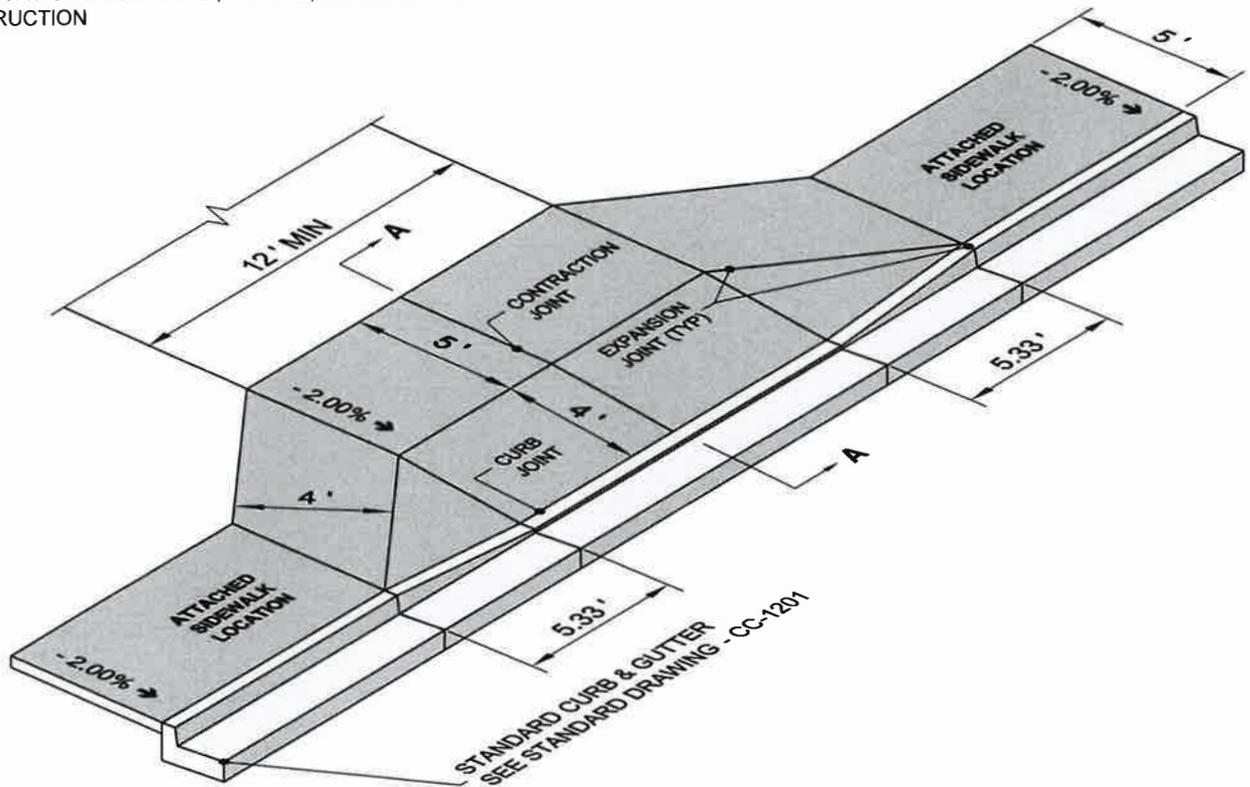

ISOMETRIC VIEW

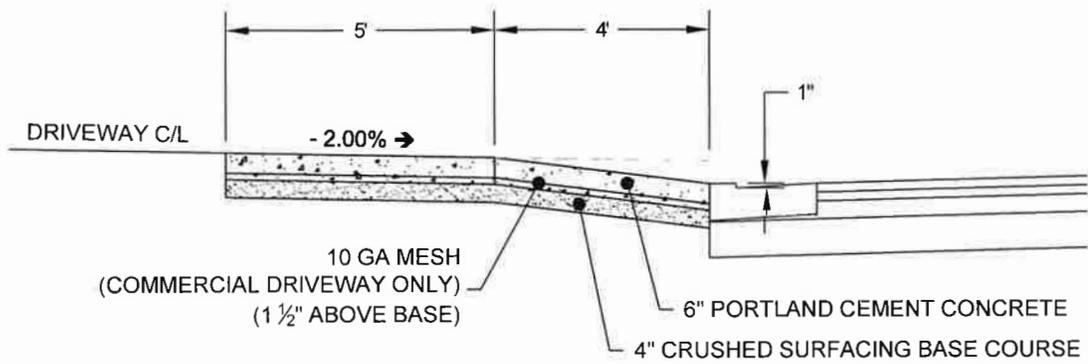

SECTION "A-A"

NOTES:

1. Concrete shall have a minimum breaking strength of 3000 p.s.i. after 28 days - 6 sack mix.
2. Curb joint shall be a troweled joint with a minimum 1/2" radius adjacent to the back of curb.
3. Expansion joints shall be 3/8" premolded, and conform to WSDOT Spec. 9-04.1.
4. Finish to be broomed perpendicular to the curb/gutter line.

<p>CPA DESIGNED BY SJM 3/5/25 DRAWN BY <i>[Signature]</i> APPROVED BY 3/17/25 DATE</p>	<p>STANDARD APPROACH FOR CURB AND GUTTER</p> <p>ATTACHED SIDEWALK N T S</p>		<p>DEPARTMENT OF PUBLIC WORKS</p> <p>207 4th AV. NORTH KELSO, WASHINGTON 98626</p> <p>DRAWING:CC-1316</p>	<p>SHEET 1 OF 1</p>
---	--	--	--	---