


ALL WORK SHALL BE ACCOMPLISHED IN ACCORDANCE WITH THE LATEST EDITION OF THE WSDOT STANDARD SPECIFICATIONS FOR ROAD, BRIDGE, AND MUNICIPAL CONSTRUCTION

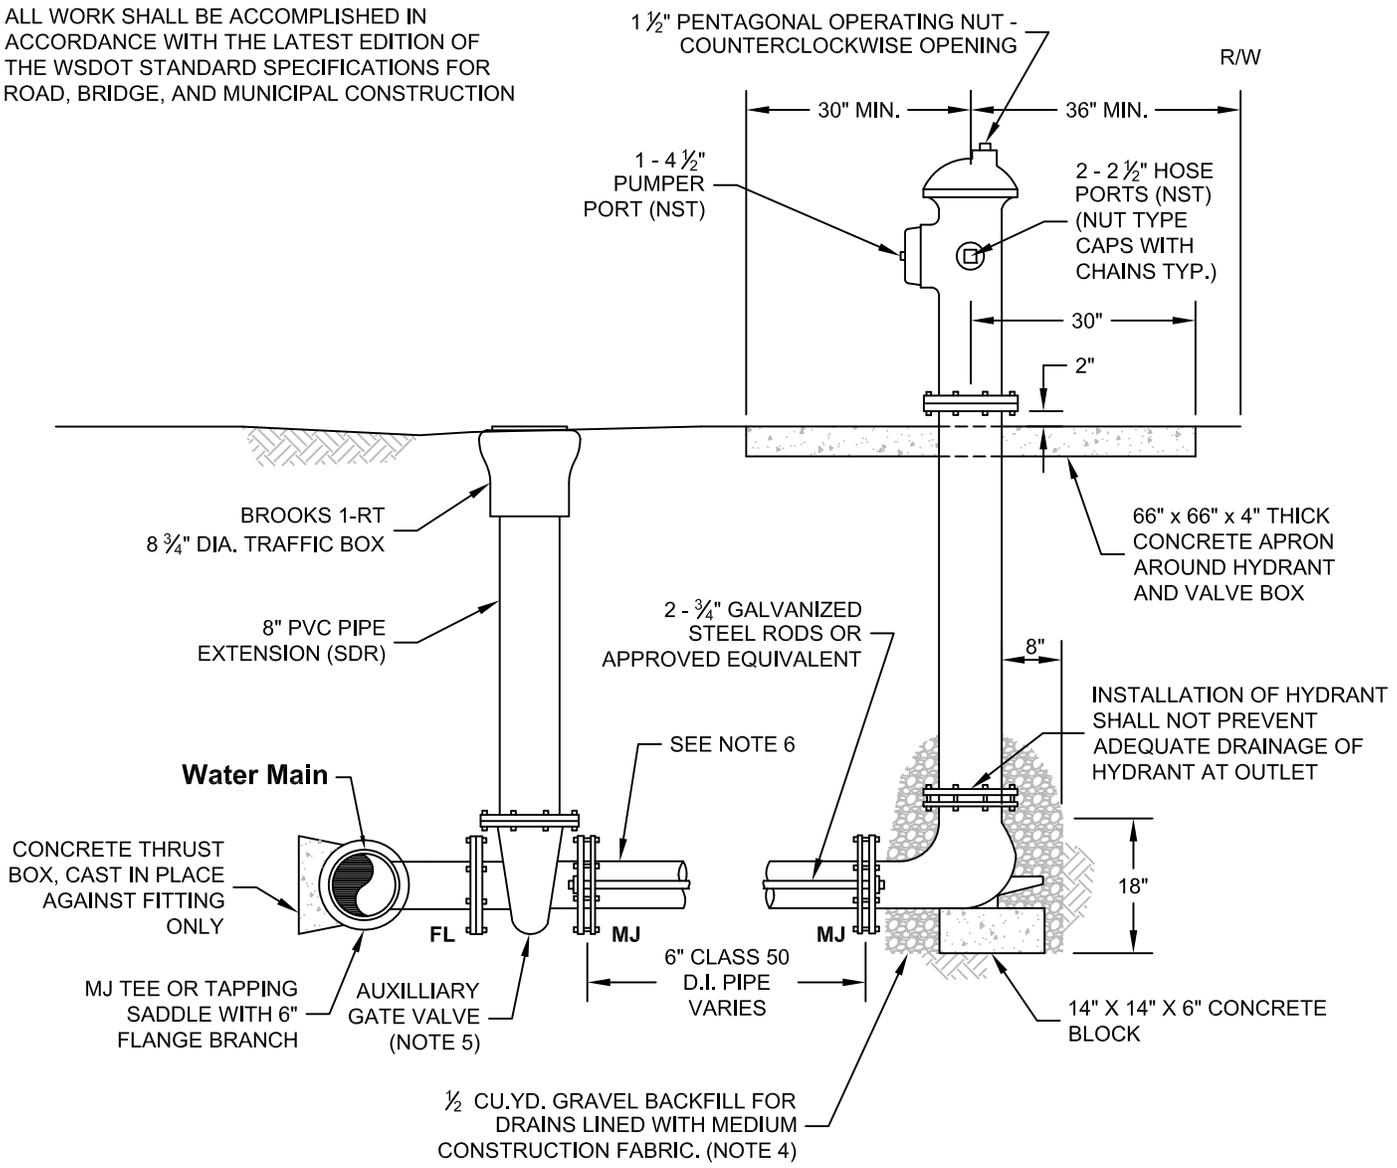

NOTES:

1. Hydrant shall be breakaway traffic model: Waterous Pacer WB67-250 or Mueller Super Centurion 250.
2. A minimum 36 inch radius unobstructed working area shall be provided around each hydrant.
3. All fittings in contact with concrete shall be wrapped in plastic.
4. Gravel Backfill for Drains shall be placed a minimum of 6" above drain outlet.
5. Hydrant valve shall be 6" Resilient Seat AWWA C 2506 Gate Valve, FLXMJ.
6. Each pipe joint 6" #1106 EBAA Iron, Inc. Megalug or approved equal, or 3/4" restraining rods, or thrust blocking as approved.

DEH
 DESIGNED BY
DJB 10/14/10
 DRAWN BY
BAB
 APPROVED BY
4/30/12
 DATE

HYDRANT SETTING DETAIL

N T S



DEPARTMENT OF PUBLIC WORKS
 1600-13th AVENUE SOUTH
 KELSO, WASHINGTON 98626
DRAWING:CC-1902

SHEET
1
 OF
1