


ALL WORK SHALL BE ACCOMPLISHED IN ACCORDANCE WITH THE LATEST EDITION OF THE WSDOT STANDARD SPECIFICATIONS FOR ROAD, BRIDGE, AND MUNICIPAL CONSTRUCTION

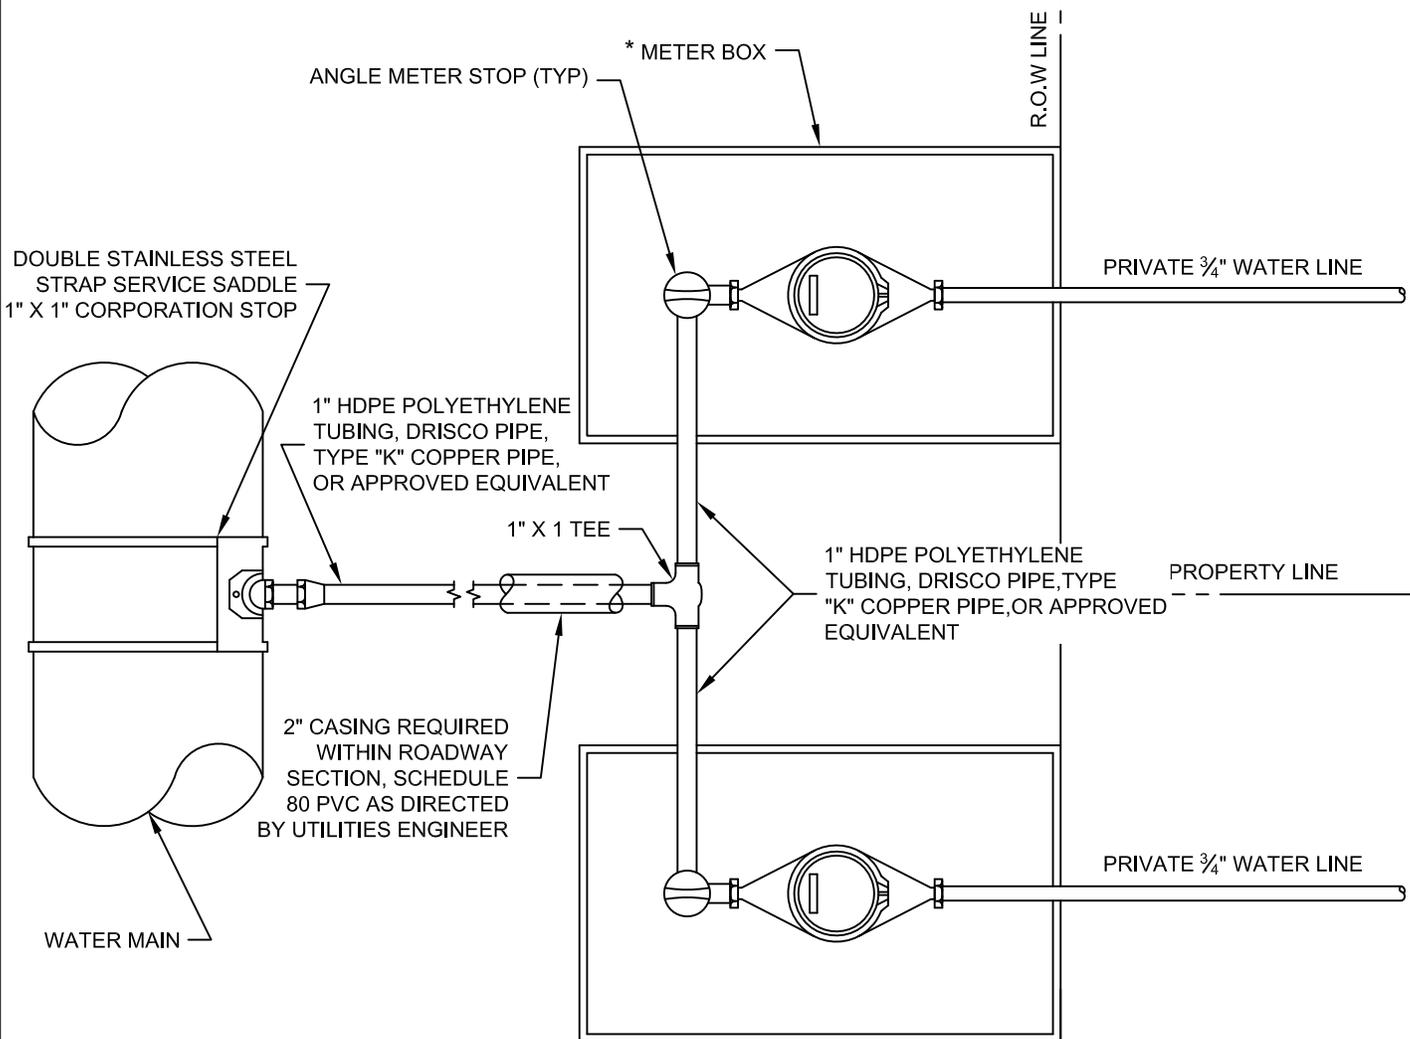

NOTES:

1. See Standard Plan CC-1908 for additional requirements.
2. County approved locate wire and/or detectable marking tape shall be installed over non-metallic lines as directed by Utilities Manager. Place tape approximately 1 foot above top of the line for it's full length. Detectable marking tape shall meet the requirements of WSDOT Stand specifications, Section 9-15.18

JAS
DESIGNED BY
JMC 11/17/05
DRAWN BY
BAB
APPROVED BY
4/30/12
DATE

DUAL WATER SERVICE CONNECTION, 3/4" METER

N T S



DEPARTMENT OF PUBLIC WORKS

1600-13TH AVENUE SOUTH
KELSO, WASHINGTON
98626

DRAWING:CC-1907

SHEET
1
OF
1