


ALL WORK SHALL BE ACCOMPLISHED IN ACCORDANCE WITH THE LATEST EDITION OF THE WSDOT STANDARD SPECIFICATIONS FOR ROAD, BRIDGE, AND MUNICIPAL CONSTRUCTION

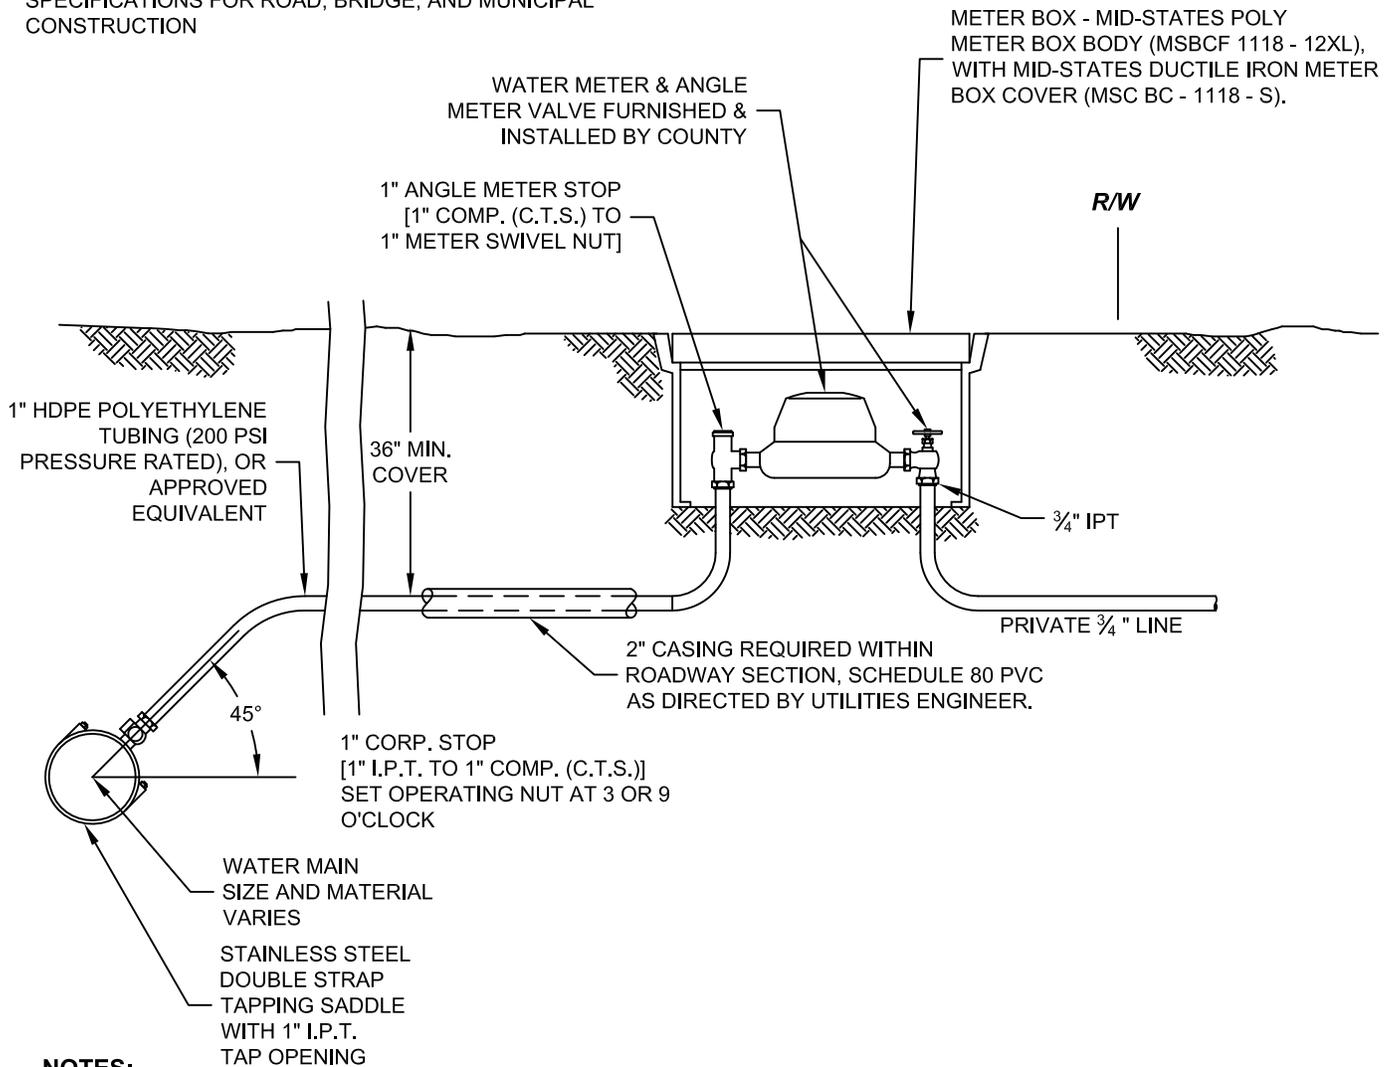

**NOTES:**

1. Bed all around main, service line, and meter base with 6" Min. depth Crushed Surfacing Top Course, or approved equivalent.
2. Backfill excavation with suitable onsite or imported material, compacted to 95% of the materials maximum density, as required in the road Right of Way Permit.
3. The water service line shall not be installed in the same trench with other utilities. The minimum lateral clearances are:
 

Telephone and Cable	TV	-	3 FEET
	Power	-	3 FEET
	Sewer	-	10 FEET
4. County approved locate wire and/or detectable marking tape shall be installed over non-metallic lines as directed by Utilities Manager. Place tape approximately 1 foot above top of the line for it's full length. Detectable marking tape shall meet the requirements of WSDOT Standard specifications, Section 9-15.18
5. Contractor must be licensed, bonded, insured, and have qualifying experience in municipal water works connections. Contractor shall contact County Public Works Utilities, a minimum of two working days prior to construction, to coordinate tap, tests, and approved materials for project.
6. All materials shall be for municipal water works. Corp. stop, meter stop, or other brass fittings shall be Mueller, or approved equivalent. Any deviations from County Standards will **NOT** be approved.

DEH  
DESIGNED BY  
DJB 1/14/11  
DRAWN BY  
BAB  
APPROVED BY  
4/30/12  
DATE

**WATER SERVICE CONNECTION**  
**3/4" or 1" METER**

N T S



DEPARTMENT  
OF PUBLIC  
WORKS

1600-13th AVENUE SOUTH  
KELSO, WASHINGTON  
98626

**DRAWING:CC-1908**

SHEET  
1  
OF  
1