


ALL WORK SHALL BE ACCOMPLISHED IN ACCORDANCE WITH THE LATEST EDITION OF THE WSDOT STANDARD SPECIFICATIONS FOR ROAD, BRIDGE, AND MUNICIPAL CONSTRUCTION

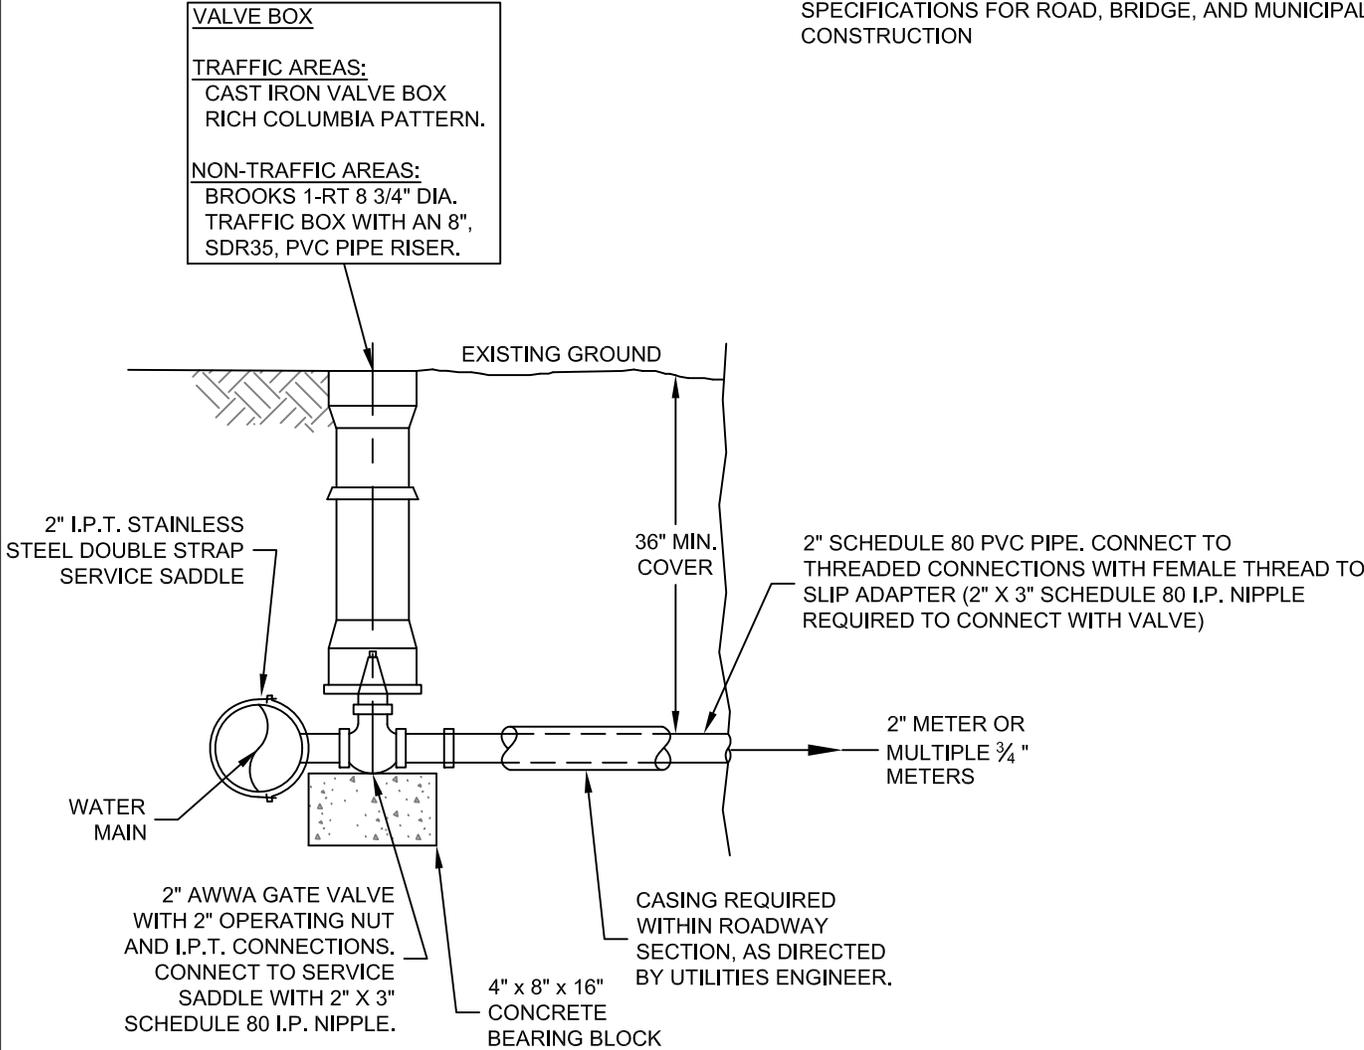

NOTES:

1. Bed all around main, service line, and meter base with Crushed Surfacing Top Course.
2. Backfill excavation with suitable onsite or imported material, compacted to 95% of the materials maximum density, as required in the road Right of Way Permit.
3. The water service line shall not be installed in the same trench with other utilities. The minimum lateral clearances are:
 - Telephone and Cable TV - 3 FEET
 - Power - 3 FEET
 - Sewer - 10 FEET
4. County approved locate wire and/or detectable marking tape shall be installed over non-metallic lines as directed by Utilities Manager. Place tape approximately 1 foot above top of the line for it's full length. Detectable marking tape shall meet the requirements of WSDOT Stand specifications, Section 9-15.18
5. Contractor must be licensed, bonded, insured, and have qualifying experience in municipal water works connections. Contractor shall contact County Public Works Utilities, a minimum of two working days prior to construction, to coordinate tap, tests, and approved materials for project. All materials shall be for municipal water works. Any deviations from County Standard Plans will **NOT** be approved. All new pipe, fittings, and appertenances shall be DISINFECTED, CHLORINE TESTED, FLUSHED, PRESURE TESTED, and BACTERIA TESTED by the Contractor per WSDOT Standard Specifications, Section 7-09, unless otherwise noted on the County Standard Plan.

DEH
 DESIGNED BY
JMC 10/26/06
 DRAWN BY
BAB
 APPROVED BY
4/30/12
 DATE

2" WATER SERVICE CONNECTION

N T S



DEPARTMENT OF PUBLIC WORKS
 1600-13TH AVENUE SOUTH
 KELSO, WASHINGTON 98626
DRAWING:CC-1909

SHEET **1**
 OF **1**