

PE CELL, FISHER PIERCE, MODEL N7790B, OR APPROVED EQUIVALENT


LIGHT FIXTURE:
THOMAS & BETTS/AMERICAN CONTEMPO 100 WATT HIGH PRESSURE SODIUM, 55 VOLT LAMP 245-57015-6A (OR APPROVED EQUIVALENT)

ALL WORK SHALL BE ACCOMPLISHED IN ACCORDANCE WITH THE LATEST EDITION OF THE WSDOT STANDARD SPECIFICATIONS FOR ROAD, BRIDGE, AND MUNICIPAL CONSTRUCTION


NOTE:

For bases poured in the sidewalk section, a minimum 5' walk path is required around pole (See County Standard Plan CC-1206)


POLE:
HPACO 78-008 TAPERED ALUMINUM TUBE, 0.125" WALL, ALLOY 6063-T6 OR APPROVED EQUIVALENT

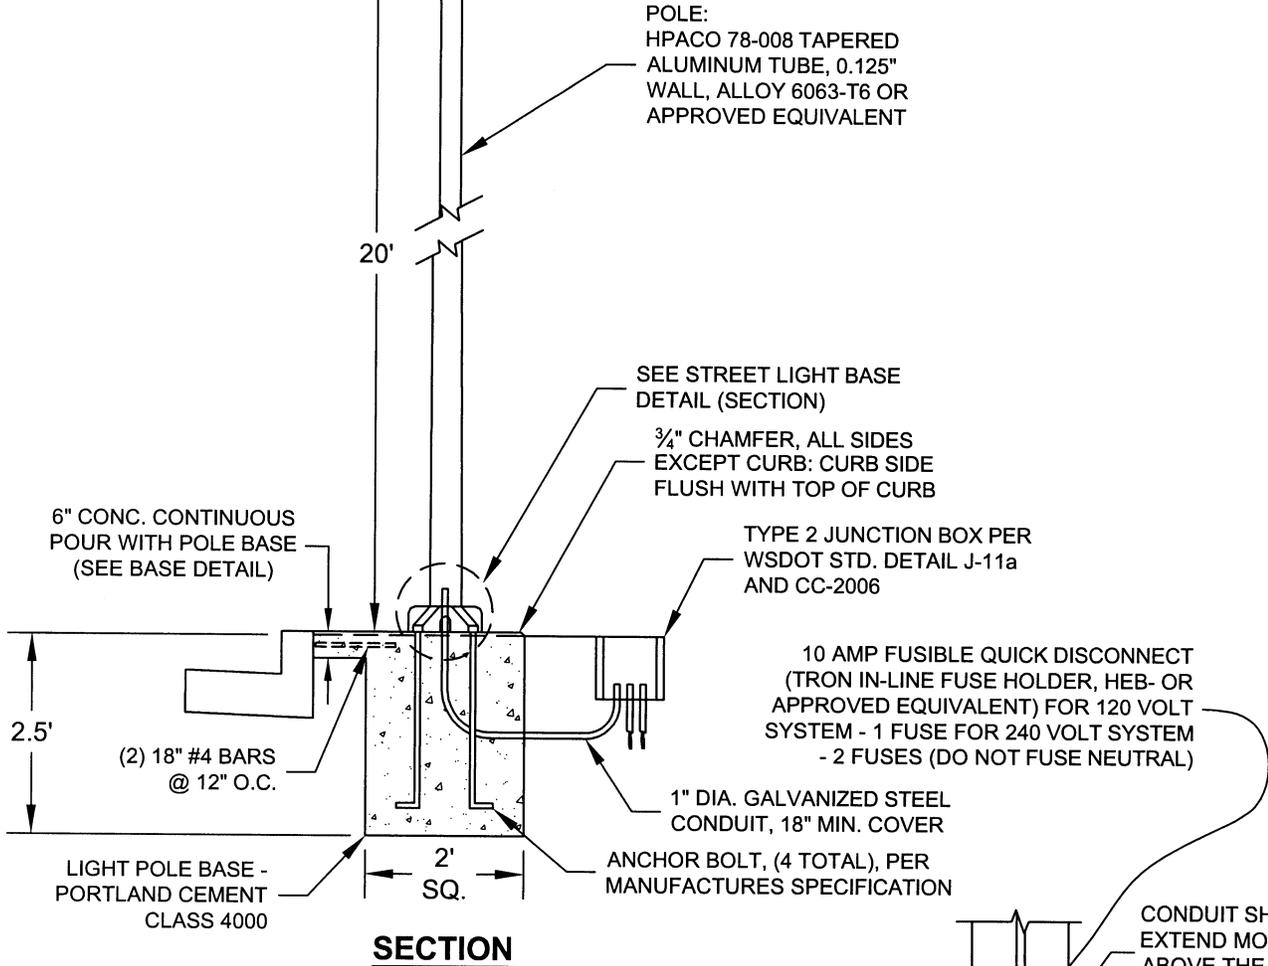

SECTION

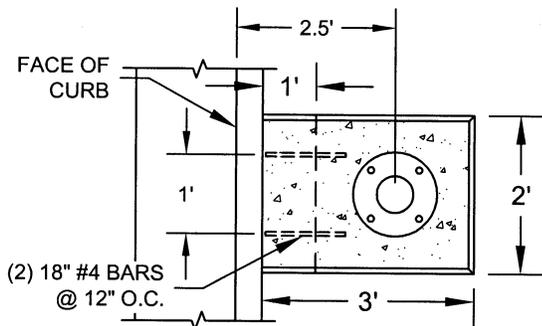

BASE DETAIL (PLAN)

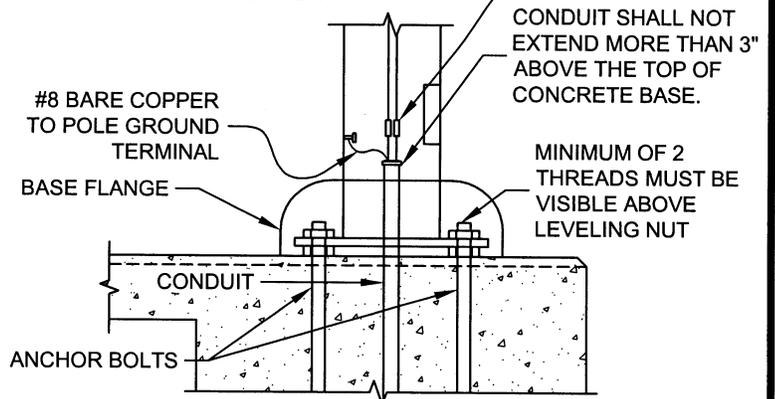

BASE DETAIL (SECTION)

RGL
DESIGNED BY
JMC 3/6/07
DRAWN BY
KAC
APPROVED BY
3-21-07
DATE

**20' STREET LIGHT
POLE DETAIL**

NTS



DEPARTMENT
OF PUBLIC
WORKS

207 4th AV. NORTH
KELSO, WASHINGTON
98626

DRAWING:CC-2003

SHEET
1
OF
1