


ALL WORK SHALL BE ACCOMPLISHED IN ACCORDANCE WITH THE LATEST EDITION OF THE WSDOT STANDARD SPECIFICATIONS FOR ROAD, BRIDGE, AND MUNICIPAL CONSTRUCTION

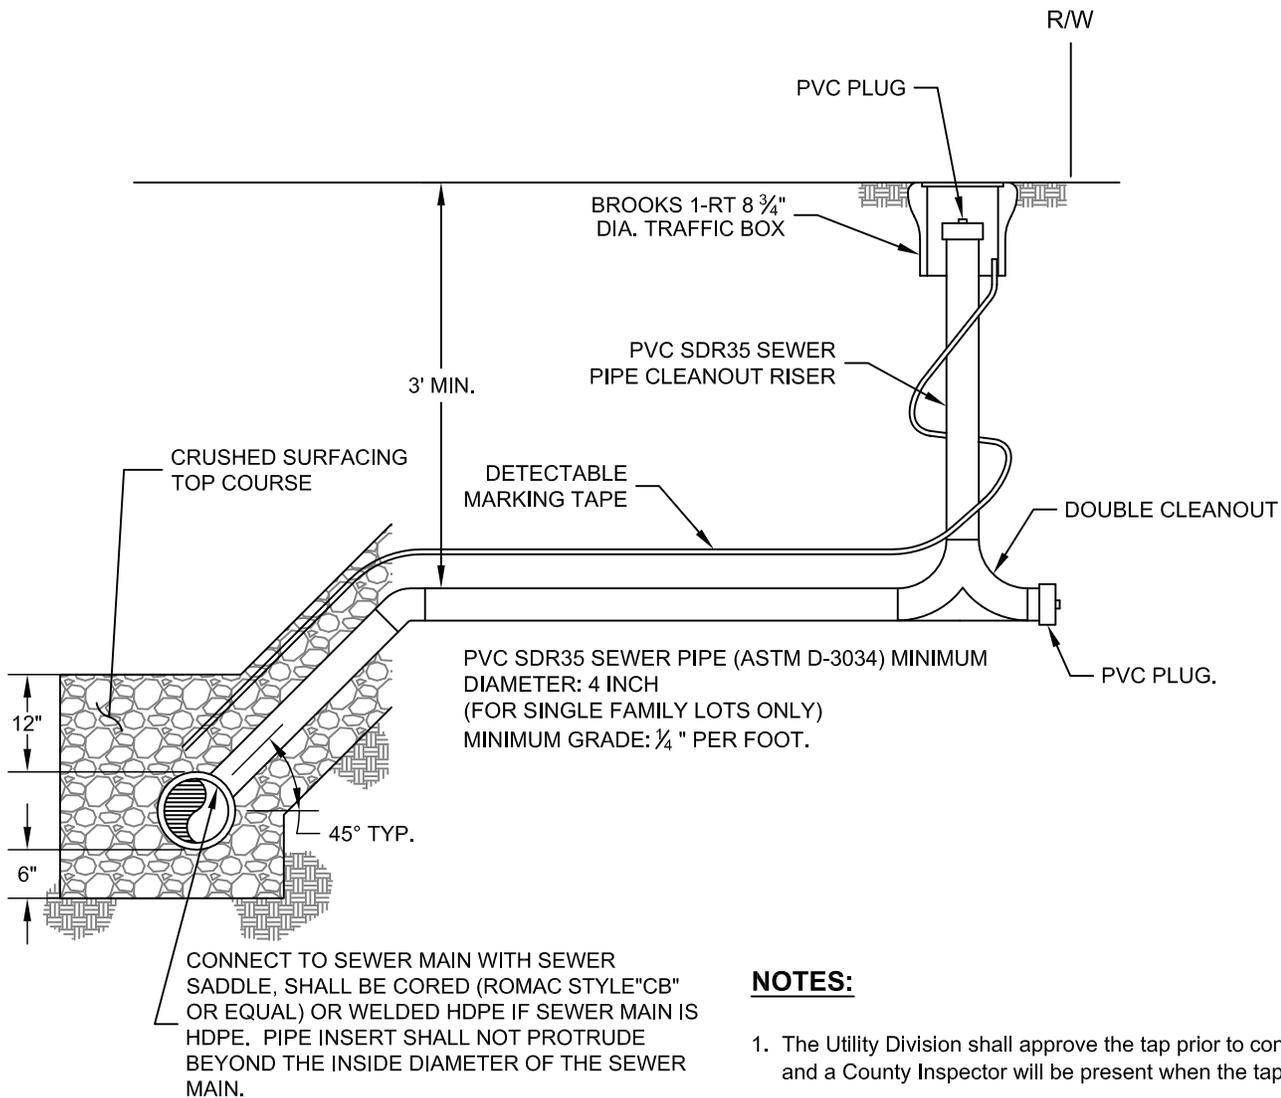

NOTES:

1. The Utility Division shall approve the tap prior to connection and a County Inspector will be present when the tap is made.
2. The lateral shall not be backfilled prior to Inspection.
3. Detectable marking tape shall be installed over non-metallic lines. Place tape approximately 1 foot above top of the line for its full length. The detectable marking tape shall meet the requirements of WSDOT Standard specifications, Section 9-15.18.
4. Tracer wire shall be #14 AWG Copperhead Super Flex High Strength Copper-Clad Steel (HS-CCS) insulated with 30 mil HDPE, or pre-approved equal. If underground splices are unavoidable, use Copperhead Snake Bite Splicer or pre-approved equal. Wire shall be colored green for sewer.
5. Sewer lateral connection shall be pressure tested according to WSDOT Standard specifications, Section 7-17.3(2)F.

DEH
DESIGNED BY
DJB 1/14/11
DRAWN BY
BAB
APPROVED BY
4/15/13
DATE

GRAVITY SEWER LATERAL CONNECTION DETAIL

NTS



DEPARTMENT OF PUBLIC WORKS

1600-13th AVENUE SOUTH
KELSO, WASHINGTON
98626

DRAWING: CC-1931

SHEET
1
OF
1